

UVGERMI®

ULTRAVIOLETS DE HAUTE TECHNOLOGIE

*Specialist in
microbiological water treatment
using ultraviolet reactors.*

● ○ ● MADE IN FRANCE

17000780_A_FT10

GERMI AP 75 E

> **Average flow:** 3 m³/h

The GERMi AP 75 E is a reliable, efficient and economical piece of equipment. It can be used to treat spring water, borehole water, supply water or water from a well contaminated by bacteria. To guarantee drinking water quality, the water must be chemically drinkable before the UV treatment.



Full warranty: 1 year

After-sales in France

TECHNICAL SPECIFICATIONS

ACS no. ACCESSORIES: No. 15 ACC LY 331, *Certificate provided on request.*

Equipment to treat a water flow rate of 2.4 m³/h to 4 m³/h for transmittance values between 92% and 98%, and a UV dose from 25 mJ/cm² to 40 mJ/cm².

UV LAMP

Total electrical power: 75 Watts (1 lamp)
Germicidal power: 25 Watts UVc
Lamp service life: 9,000 hours or 1 year
 (maximum limit of 5 starts per 24-hour period)

UV REACTOR

Treatment chamber: Stainless steel 316L - IP65
Reactor diameter: 76 mm external
Reactor length: 989 mm
U-shaped entry/exit: 3/4" male screw
Maximum pressure authorised: 8 bars
Horizontal installation

ELECTRICAL BOX

Dimensions (mm): 204 x 75 x 54
Power supply: 230 V/50-60 Hz
1 light indicator for lamp operation
1 light indicator for lamp fault
1 alarm for end of lamp service life
1 counter indicating days before lamp replacement


ASSOCIATED PRODUCTS

UV lamp 75 Watts: 14000101
Quartz sleeve: 14000051
O-ring: 14000088

17000780_A_FT10

GERMI AP 75 E

> **Average flow:** 3 m³/h

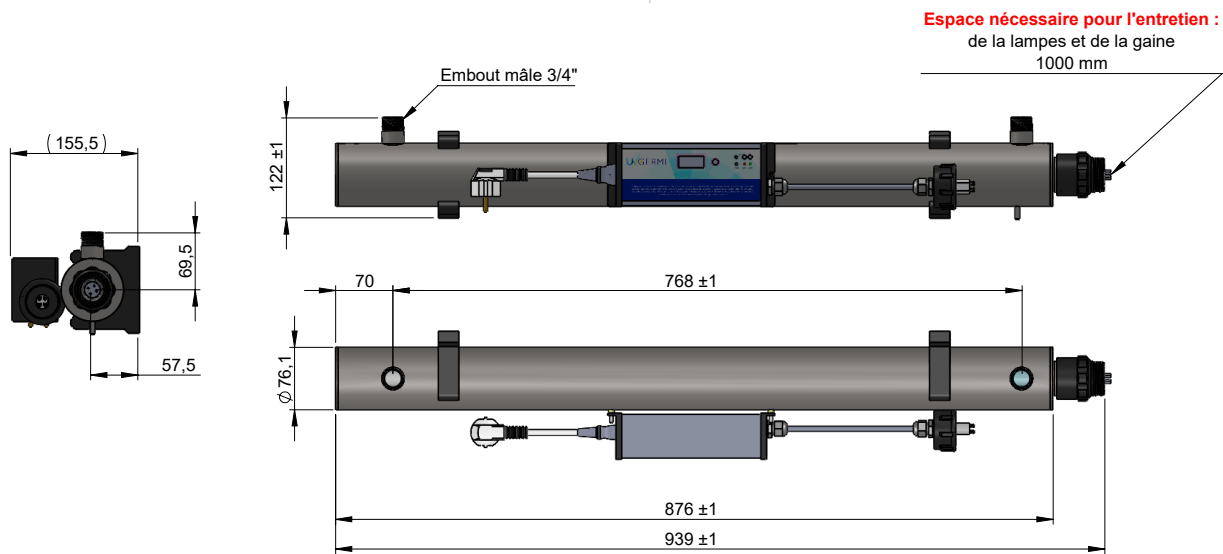

INSTALLATION

The **GERMI AP 75 E** must be mounted on the wall using the two support clips.

To enable easy maintenance of the unit, leave space of at least 1.20 m on the UV lamp exit side and install valves to isolate it. If this installation configuration is not possible, it must be possible to dismount the reactor to enable replacement of the UV lamp and cleaning of the quartz sleeve.

The effectiveness of the treatment depends on the transparency of the water. We strongly recommend installing a filtration system with a 50 µm filter screen to eliminate suspended solids before the UV treatment.

The **GERMI AP 75 E** must be protected from "water hammer" and strong vibrations. It must be protected from freezing temperatures and humidity. It must not be operated outdoors.

MAINTENANCE

Maintenance is limited to the replacement of the UV lamp and the replacement or cleaning of the sleeve. The UV lamp has a maximal service life of 9,000 hours, after which water disinfection is no longer guaranteed.

The quartz sleeve protecting the lamp makes lamp replacement much easier. The quartz sleeve may become clogged or lime scale deposits may form. It should be cleaned with mild acid.