

UVGERMI

ULTRAVIOLETS DE HAUTE TECHNOLOGIE

The microbiological water treatment specialist using ultraviolet reactors.



MADE IN FRANCE

15000143B_A_FT10

GERMI CD 300 ECI*

> **Flow:** from 87 to 130 m³/h

The GERMI CD300 ECI is specially designed for securing water resources for use in industrial processes, for producing rinse or wash water, for protecting equipment (reverse osmosis, filtration), or for producing ultra-pure water.



Full warranty: 2 years

After-sales in France



TECHNICAL SPECIFICATIONS

Equipment for treating an average water flow between 87 m³/h (T₁₀ = 90% at 254 nm) and 130 m³/h (T₁₀ = 98% at 254 nm) for a minimum UV dose of 40 mJ/cm² at the end of lamp service life.

UV LAMP

Total electrical power: 900 Watts (3 lamps)
 Germicidal power: 345 Watts UVc
 Lamp service life: 16,000 hours or 2 years
 (limited to a maximum of 5 starts per 24 hours)

UV REACTOR

Treatment chamber: Stainless steel 316L
 Input/Output: DN 150
 Operating pressure: 8 bar
 Drain valve and sampling valves UV sensor (permanent display of the intensity emitted) Temperature probe
 Fixing lugs
 *ECI: Eau Claire Industrielle (Industrial Clear Water)

ELECTRICAL BOX

Dimensions (mm): 600 x 600 x 210
 Power: 240 V / 50-60 Hz
 ON-OFF switch/Lights on indicator/
 Lamps / UV sensor display / Fault indicator / Lamp
 hour counter / Painted steel cabinet

ASSOCIATED PRODUCTS

300 W UV lamp: 14000127
 Quartz sleeve: 14000052
 O-ring: 14000113


OPTIONS

Automatic or manual cleaning using a pull tab / Vertical installation

15000143B_A_FT10

GERMI CD 300 ECI*

> Flow: from 87 to 130 m³/h

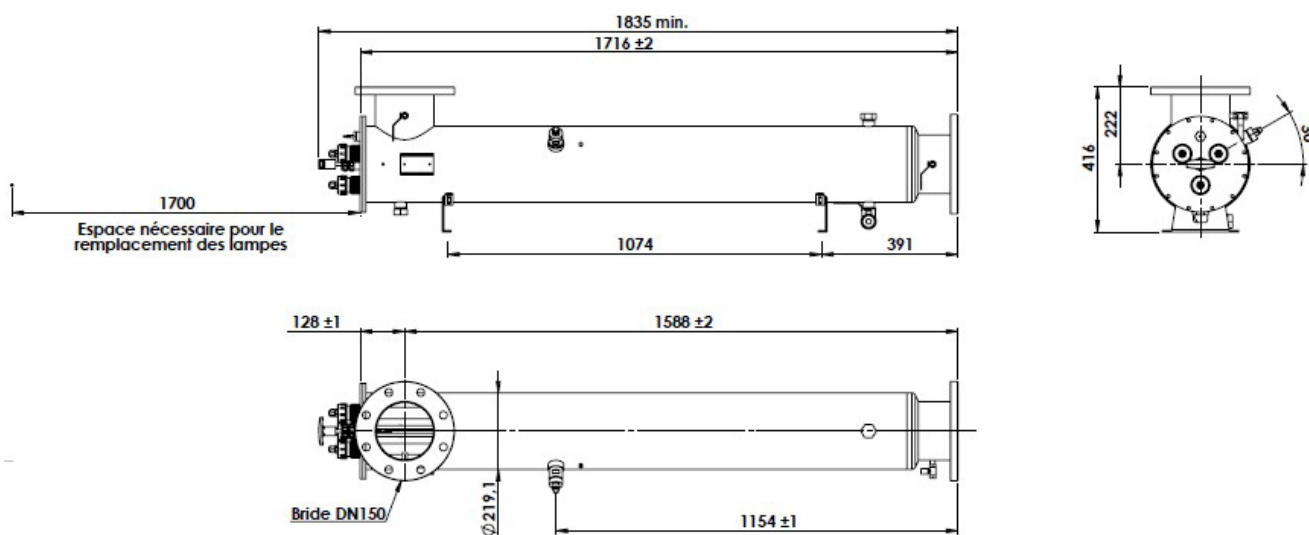

INSTALLATION

The GERMI CD300 ECI is installed on the main water supply pipe, the water inlet and outlet sides being identical. If the reactor needs to be installed vertically, an automatic air bleed must be included in the upper section of the reactor.

A gap must be left on the lamp removal side (1 m minimum) or the unit (bypass) must be easy to dismantle for maintenance operations.

MAINTENANCE

The reactor requires little maintenance and monitoring: only the lamp service life and quartz sleeve fouling need to be monitored. When the UV lamps reach the end of their service life, efficiency losses will become noticeable. The lamps must be replaced after 16,000 hours or 2 years in operation.

The quartz sleeves considerably simplify the replacement of the lamps, without having to drain or dismantle the entire unit. Fouling in the sleeve may occur, in which case it must be cleaned 1 to 3 times a year with a mild acid depending on the nature of the water. The quartz sleeves must be replaced every 4 to 5 years.