

UVGERMI®

ULTRAVIOLETS DE HAUTE TECHNOLOGIE

*Specialist in
microbiological water treatment
using ultraviolet reactors.*

● ○ ● MADE IN FRANCE

16000021_A_FT10

GERMI ULTRA 1000 E

> **Average flow:** 2 m³/h

This unit produces **drinking water** with an appropriate bacteriological content by combining filtration with UV disinfection. Bacteria and viruses are destroyed without using chemical substances.

APPLICATIONS:

Spring water, boreholes, wells, etc.



Full warranty: 1 year

After-sales in France



TECHNICAL SPECIFICATIONS

Flow treated:	2 m ³ /h
Total electrical power:	25 W (1 lamp)
Germicidal power:	7 W
Lamp service life:	9,000 hours or 1 year
Filtration:	50 µm (option of 5, 10 or 25 µm, activated carbon)
Input/Output:	3/4" female
Power supply:	230 V/50-60 Hz
Maximum pressure:	3 bars

CONTROL BOX

Day counter

Audible alarm if the lamp shuts down or reaches its end of life

Light indicators for lamp operation and fault


ASSOCIATED PRODUCTS

11 W UV lamp:	15000715
Quartz sleeve:	14000050
O-ring:	14000088
50 µm filter:	493823

16000021_A_FT10

GERMI ULTRA 1000 E

> **Average flow:** 2 m³/h

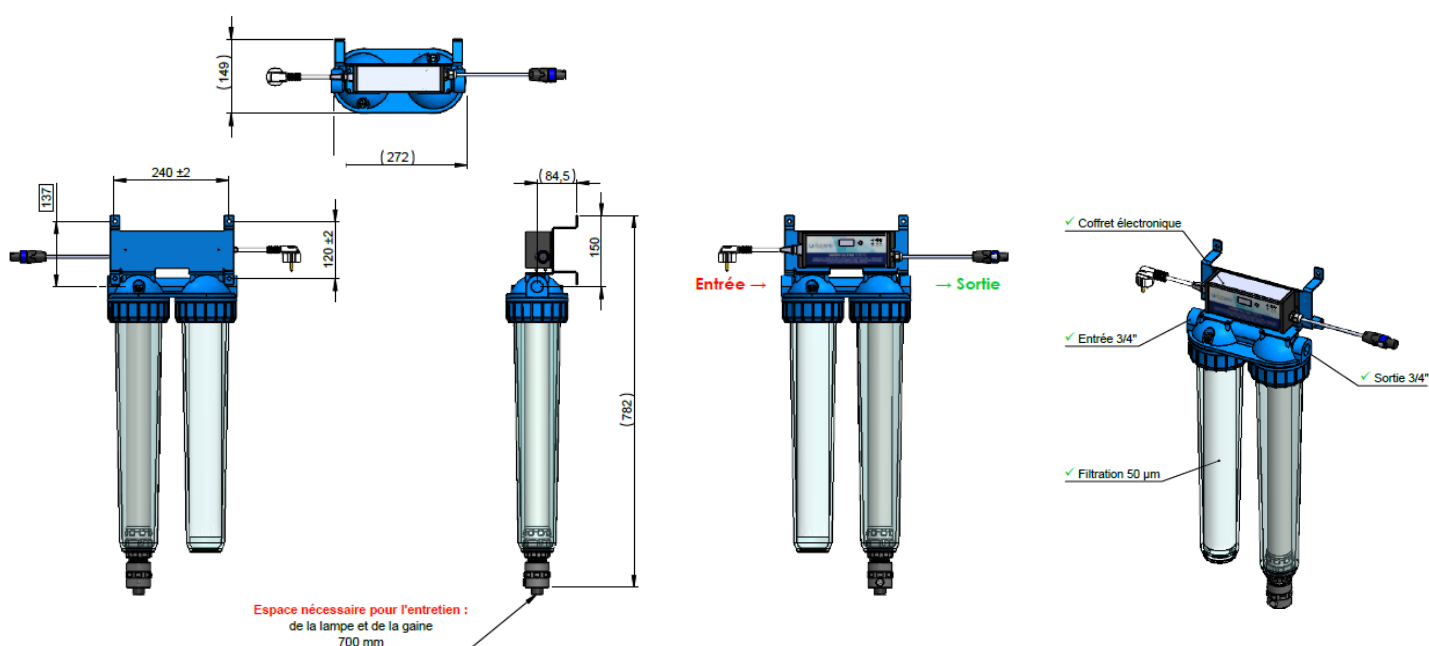

INSTALLATION

The **GERMI ULTRA 1000 E** is installed on the main water supply pipe. It can be secured to the wall with its mounting system. It should be positioned vertically. Sufficient space must be left below the **GERMI ULTRA 1000 E** (at least 700 mm) or provide for easy dismantling of the unit (bypass) to replace the UV lamp and the cartridge.

The device must be protected against "water hammer" using a water hammer protection device (pressure vessel, shock absorber, etc.) if needed. It must be protected from frost, excessive heat and humidity (indoor installation).

MAINTENANCE

Maintenance is limited to the replacement of the UV lamp and the replacement or cleaning of the filter cartridge. The UV lamp has a maximal service life of 9,000 hours, after which water disinfection is no longer guaranteed.

The quartz sleeve protecting the lamp makes lamp replacement much easier: there is no need to drain or dismantle the **GERMI ULTRA**. The quartz sleeve may become clogged or lime scale deposits may form. It should be cleaned with a clean cloth and mild acid.

**The GERMi ULTRA 1000 E can produce drinking water provided the incoming water is chemically drinkable.*